

SC-2000

NOTE 2: Connections TE-Dx share the same IP Address

NOTE 3: Connections BE-Dx share the same IP Address


Control Network

SNMP Network


Control Network

SNMP Network


NOTE 1: We recommend that the Network infrastructure use for the Control and SNMP networks are kept on a physically different network.

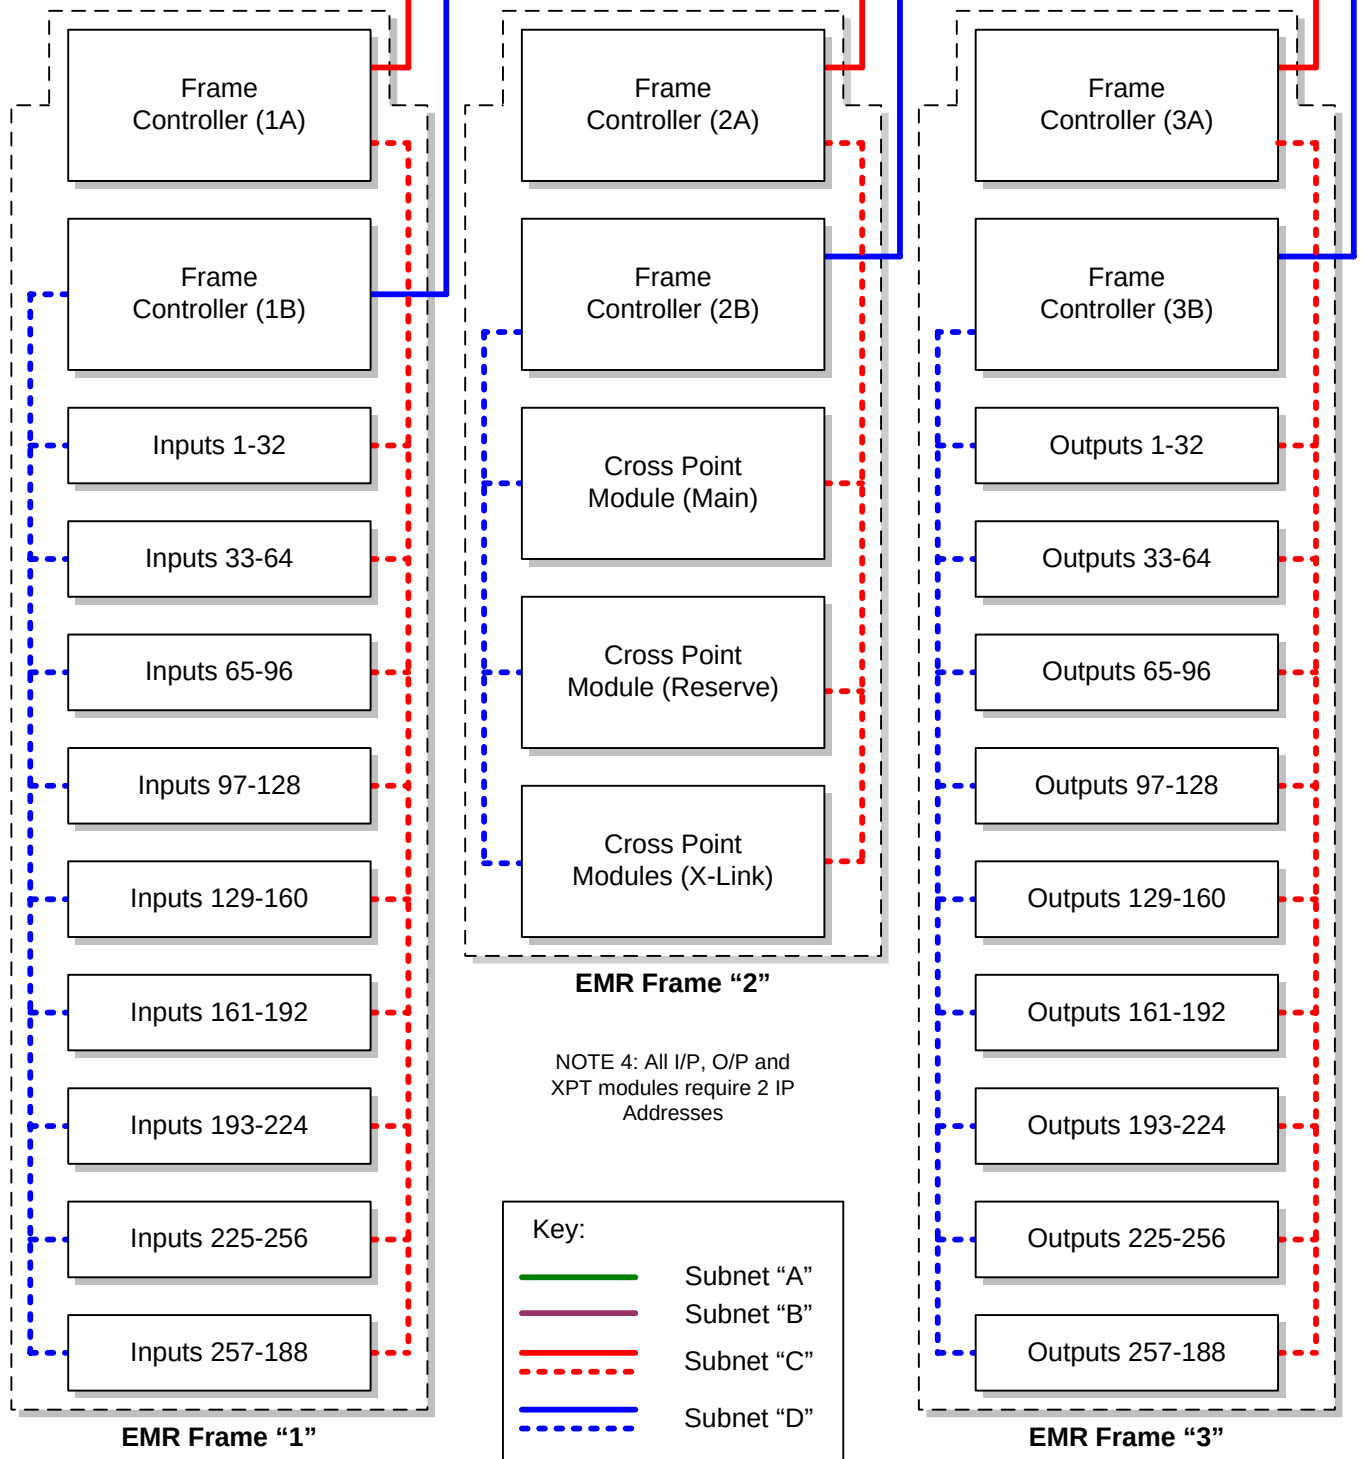

Example 1
EMR 128x128 (single cross point)

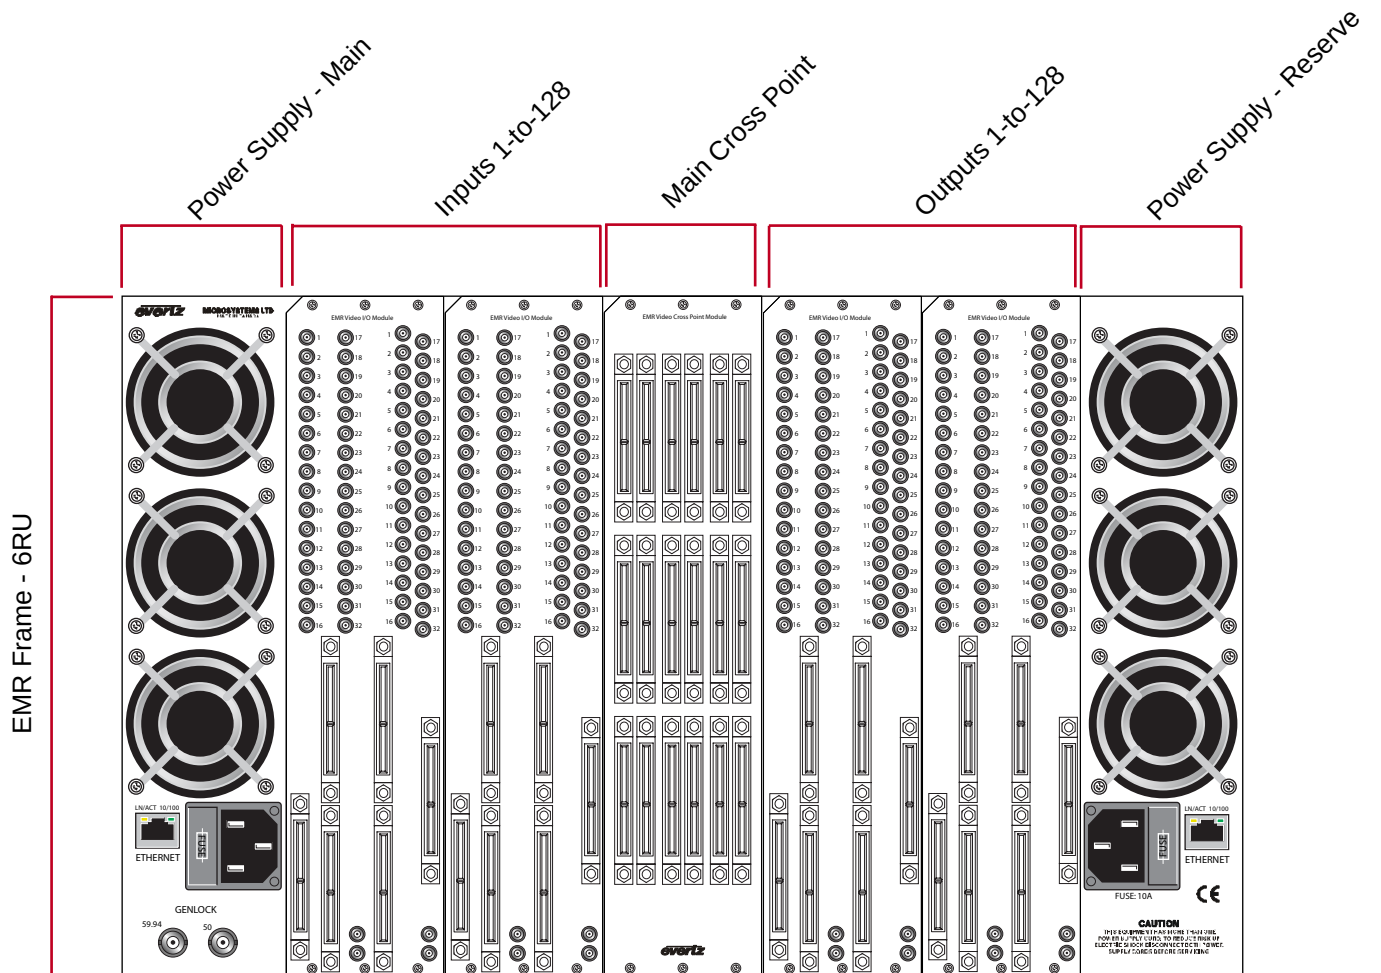

Example 2
EMR 96x96 (main & redundant cross point)

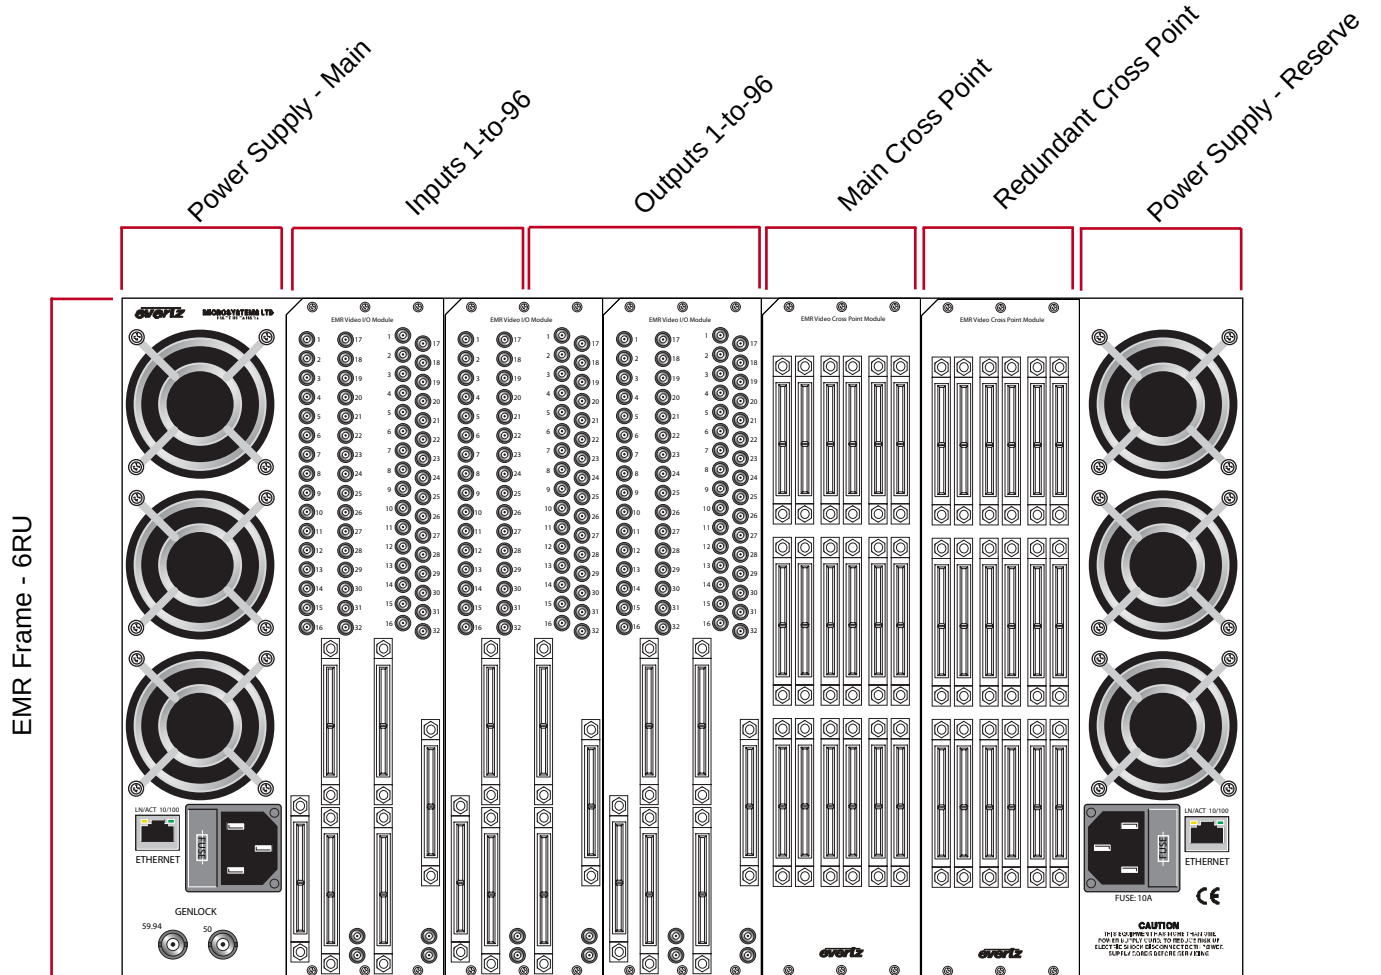

Example 3
EMR 288x2288 (Single Cross Point)


Power Supply - Main

Inputs 1-to-256


Main Cross Point

Power Supply - Reserve

EMR Frame - 6RU

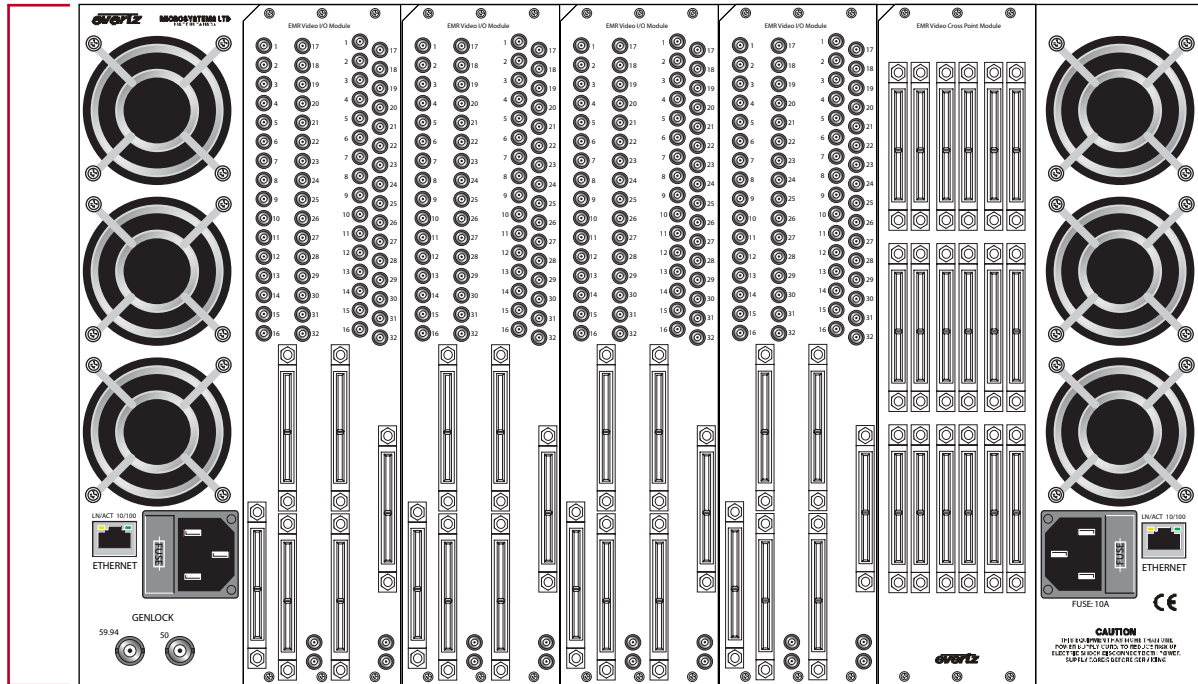


EMR Frame - 6RU

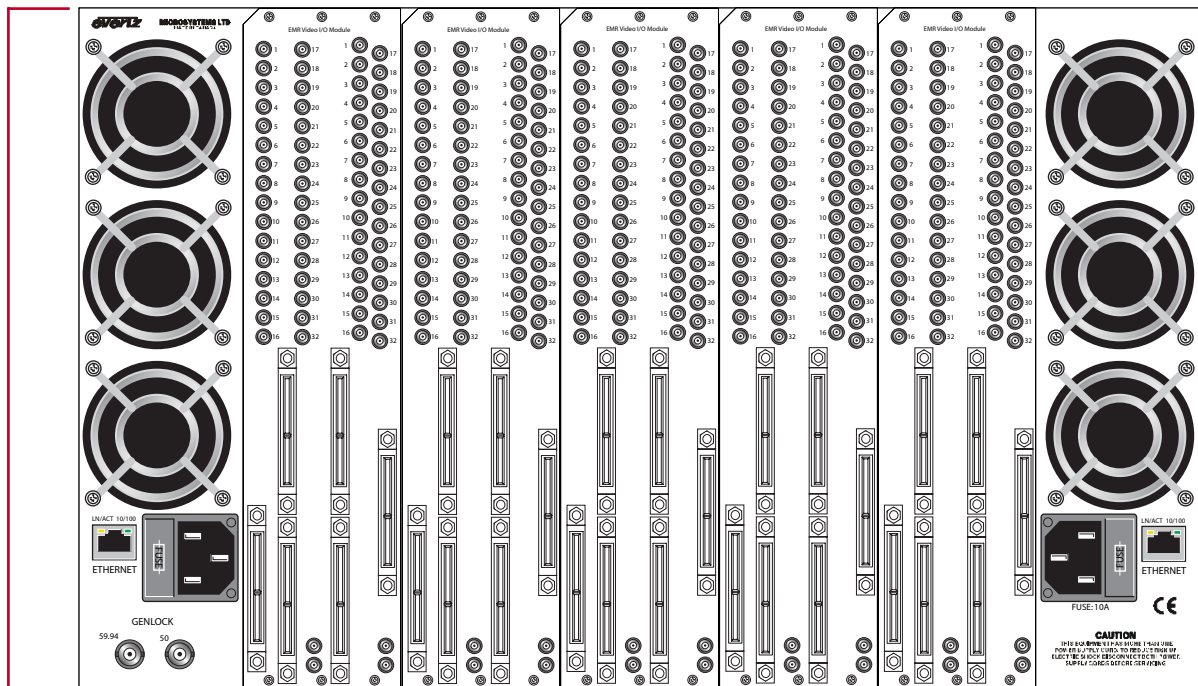


Outputs 1-to-288

Inputs 257-to-288


Example 4
EMR 256x256 (Main & Redundant Cross Point)

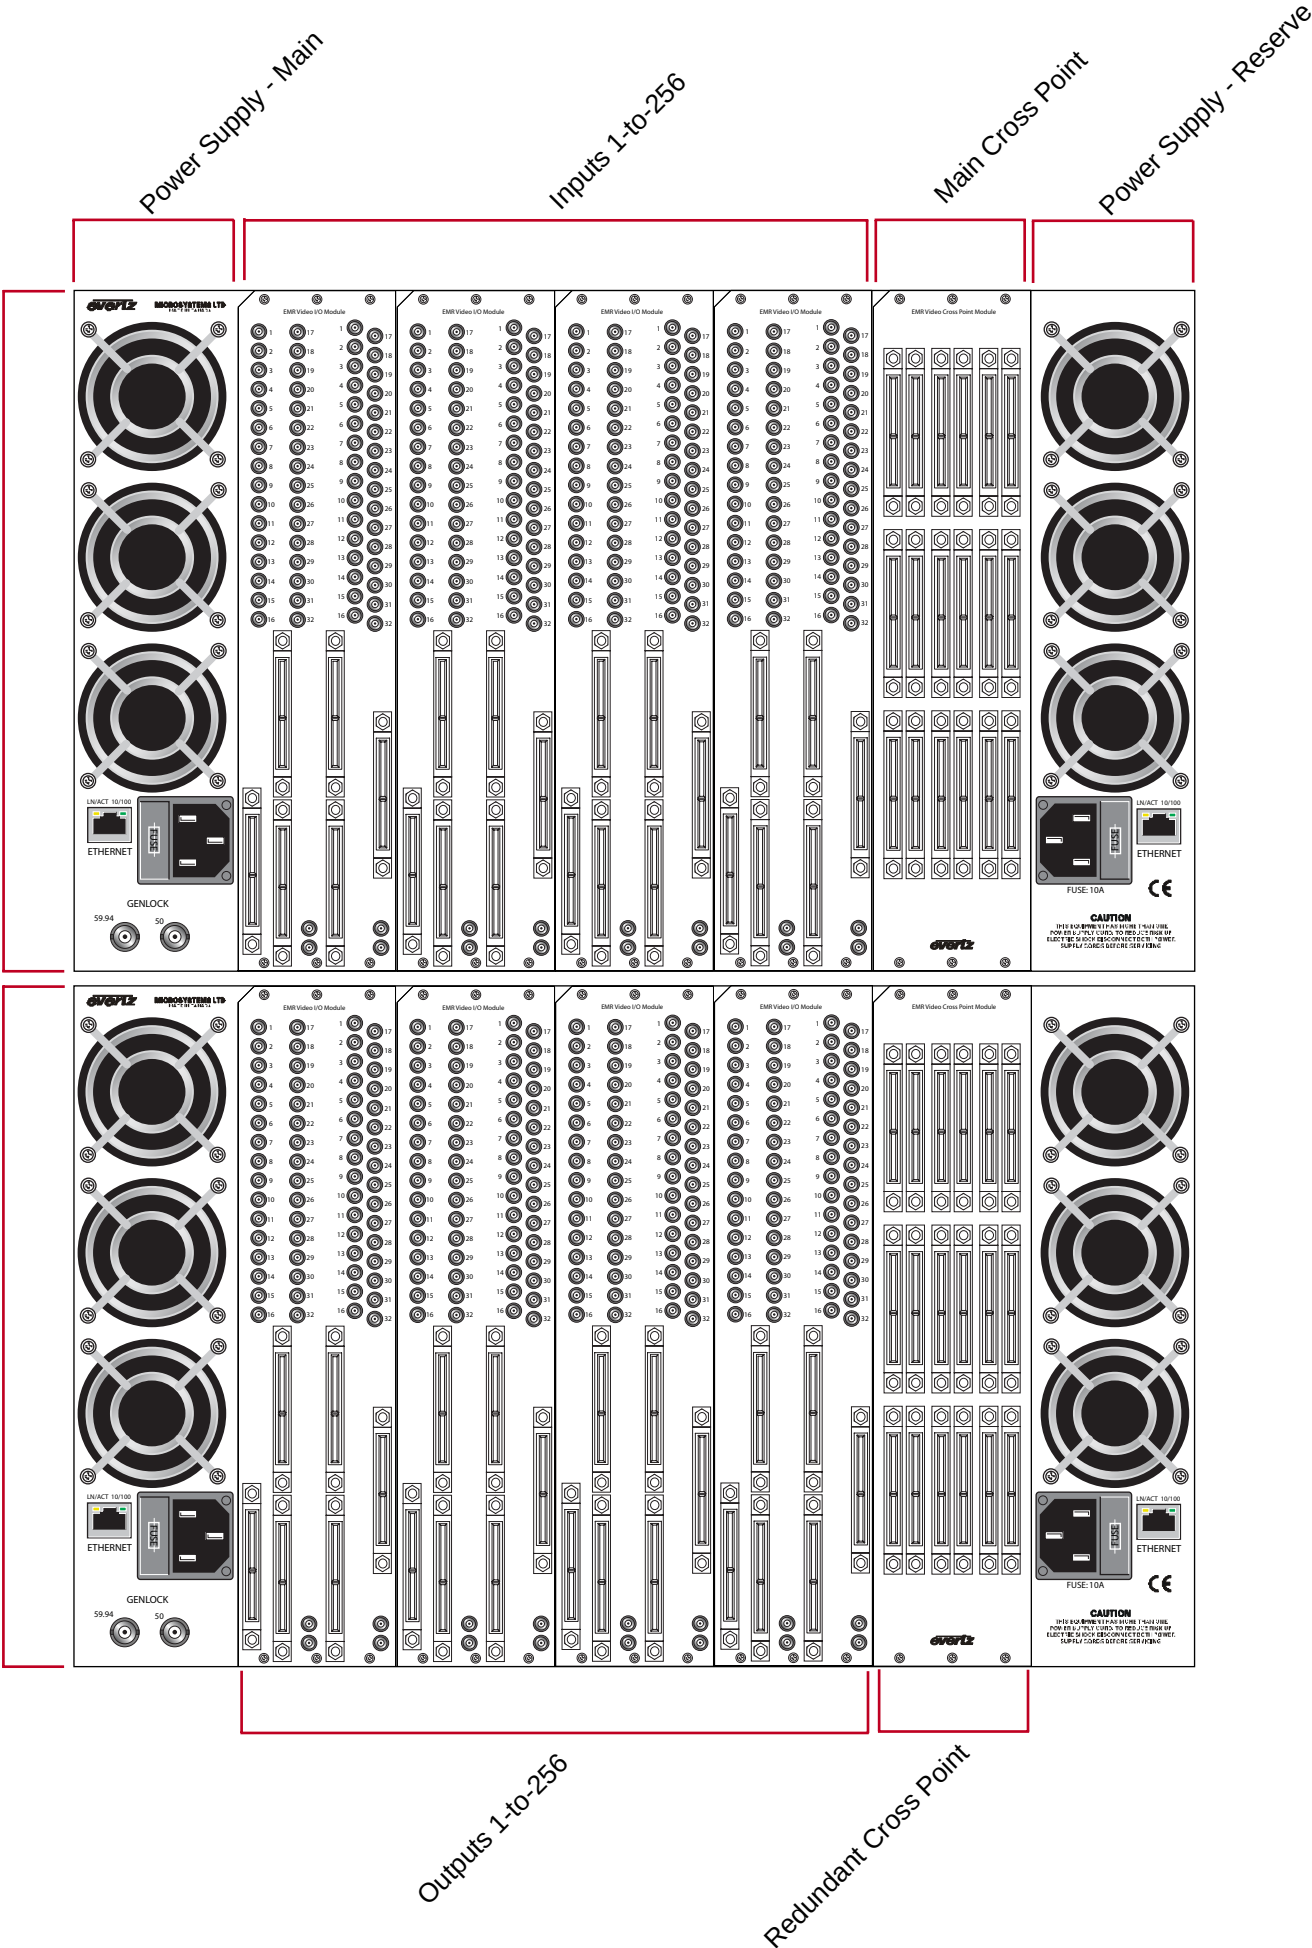

Example 5
EMR 64x64 +288 X-Link (main & redundant cross point)

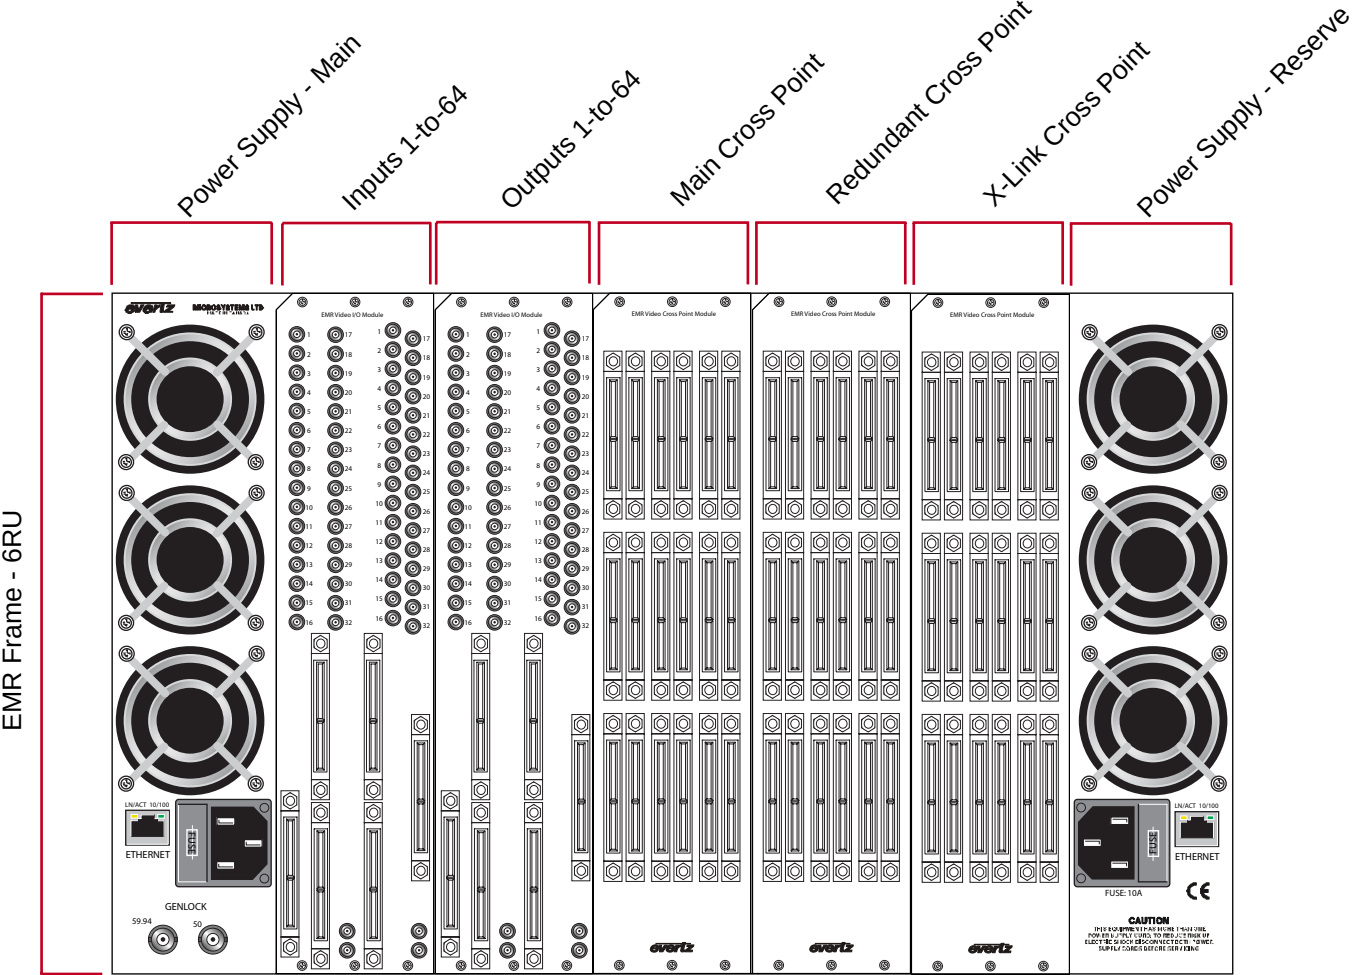

Example 6
EMR 224x224 +288 X-Link (Main & Redundant Cross Point)

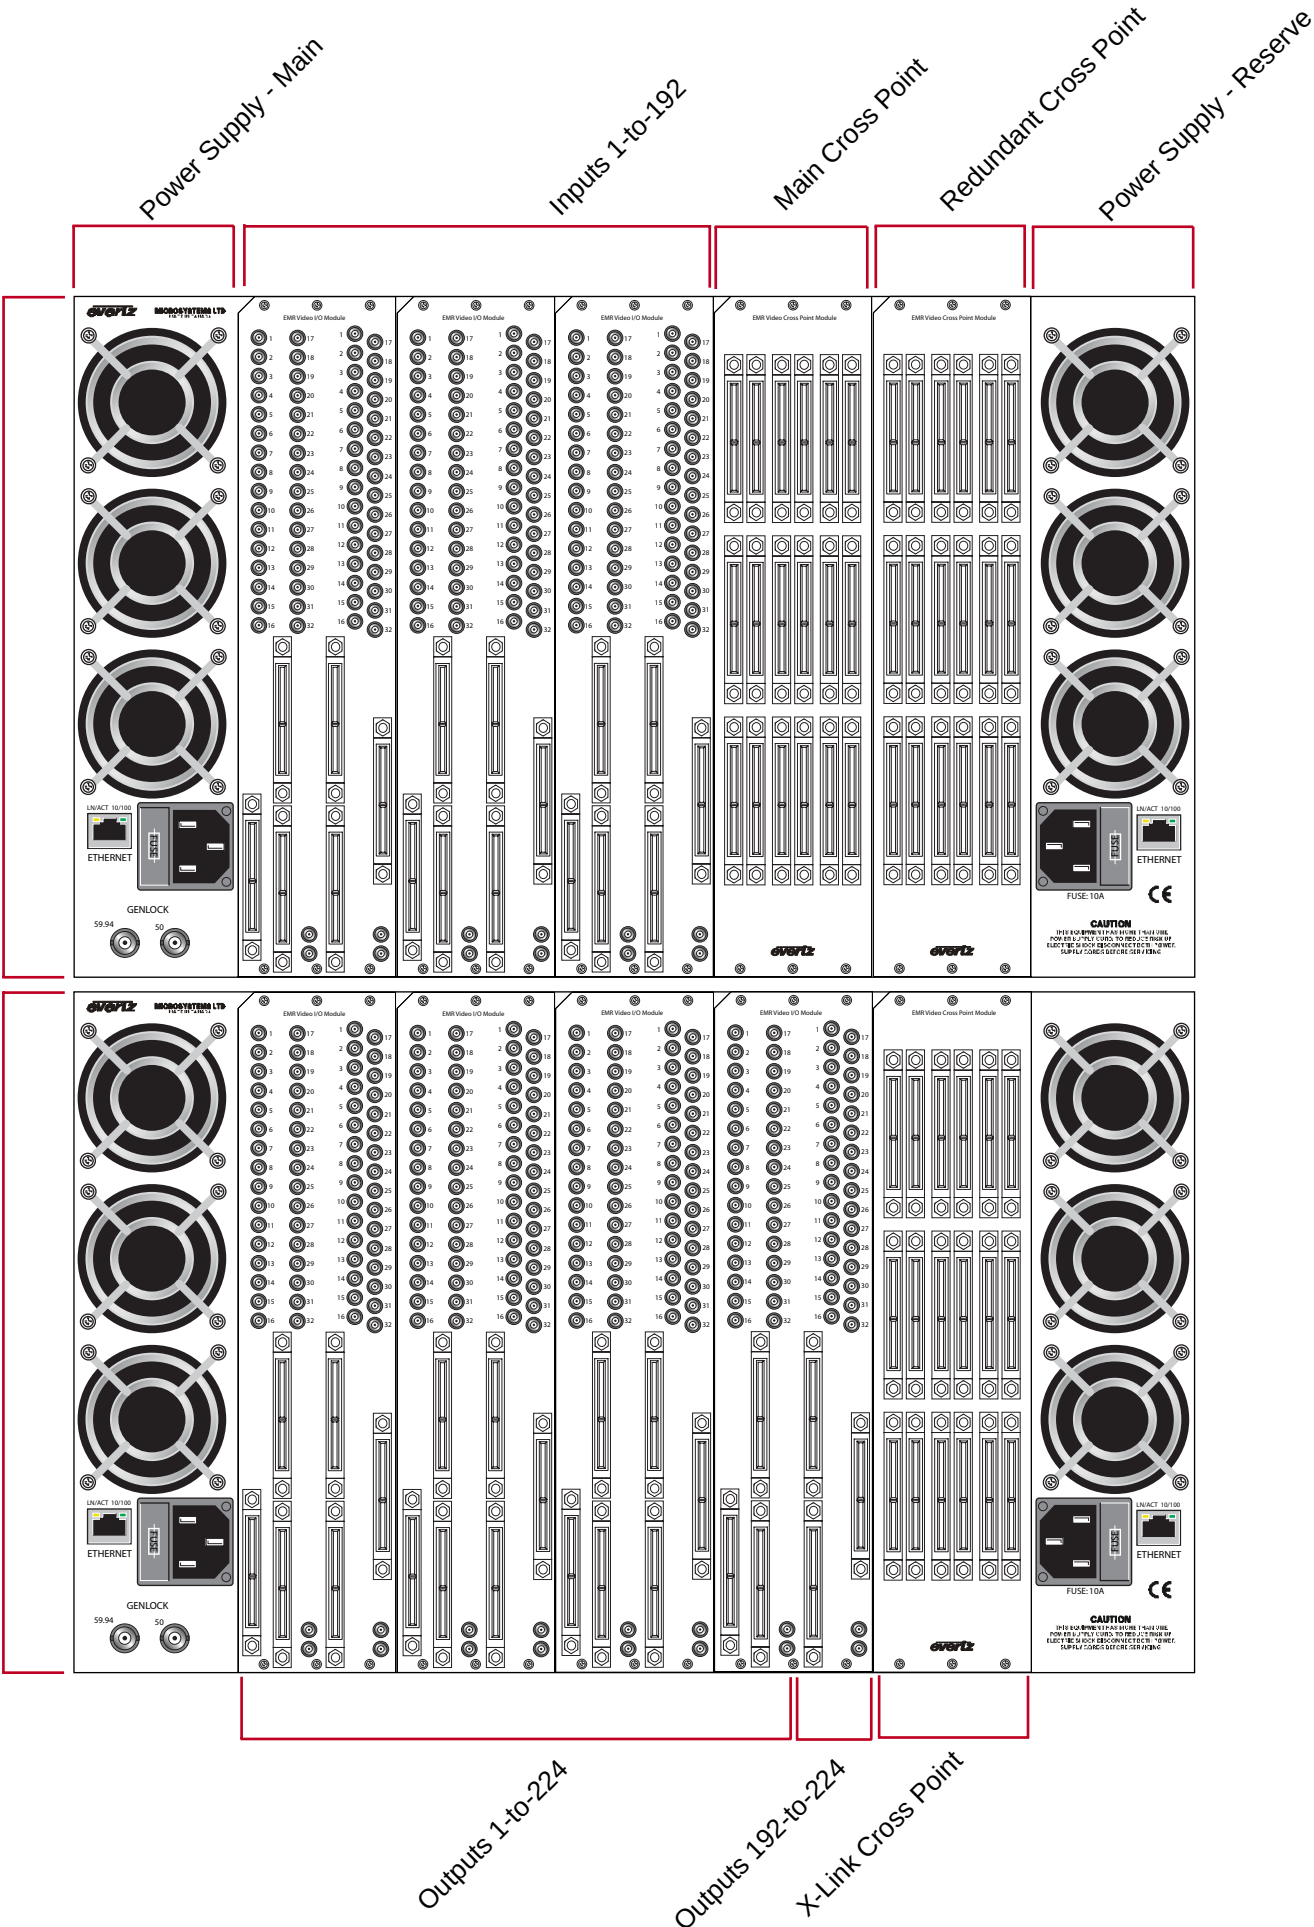

Example 7
EMR 288x288 +288 X-Link (Main & Redundant Cross Point)

